


NOTE:

HYDRANT SHALL BE SET WITH BREAK OF FLANGE NO LESS THAN 2" ABOVE FINAL GRADE AND NO GREATER THAN 10" ABOVE FINAL GRADE

WATER PLACEMENT DOES NOT HAVE TO BE UNDER PAVEMENT IF ALTERNATE IS APPROVED ON THE PROJECT PLANS.

IN OPEN SECTION ROADS, THE WATER MAIN WILL NOT BE UNDER THE PAVEMENT.

ALL PIPING SHALL BE INCASED IN 6" OF STONE DUST ON ALL SIDES.

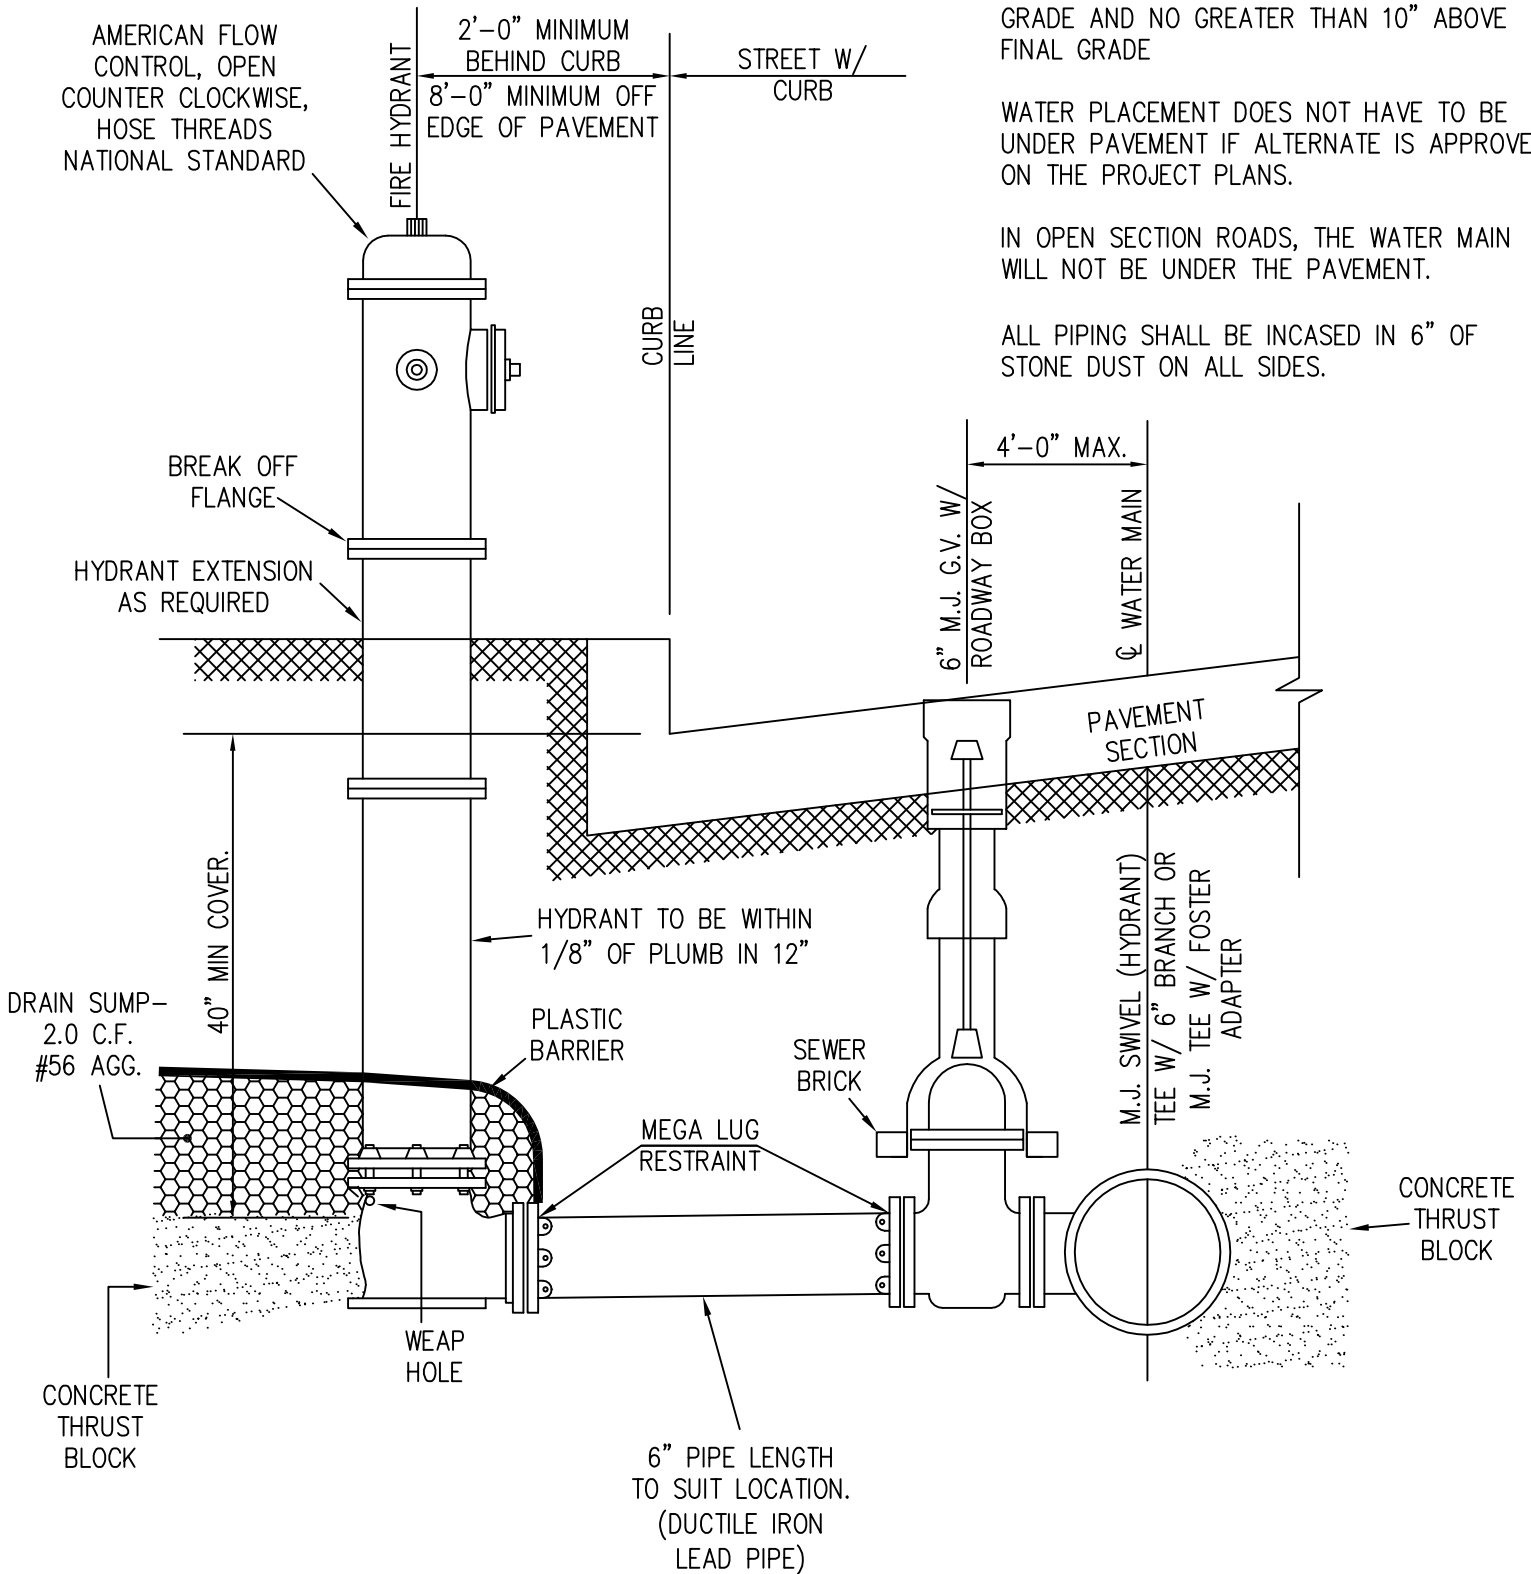

**Jefferson Utilities Inc.**

270 Industrial Boulevard  
Kearneysville, WV 25430

## FIRE HYDRANT SETTINGS

•Not to Scale•

# W-3.02

REVISED:  
AUGUST 6, 2013