


NOTE:

1. SEE THRUST BLOCK DETAIL FOR REQUIRED THRUST BLOCKS.
2. PIPE SHALL BE WRAPPED IN PLASTIC 4 MIL SHEETING AND INCASED IN CONCRETE FROM MJ TAP TO 1' PAST THE BLOWOFF INCLUDING THE KICKER, BUT NOT COVERING THE OPERATING NUT.

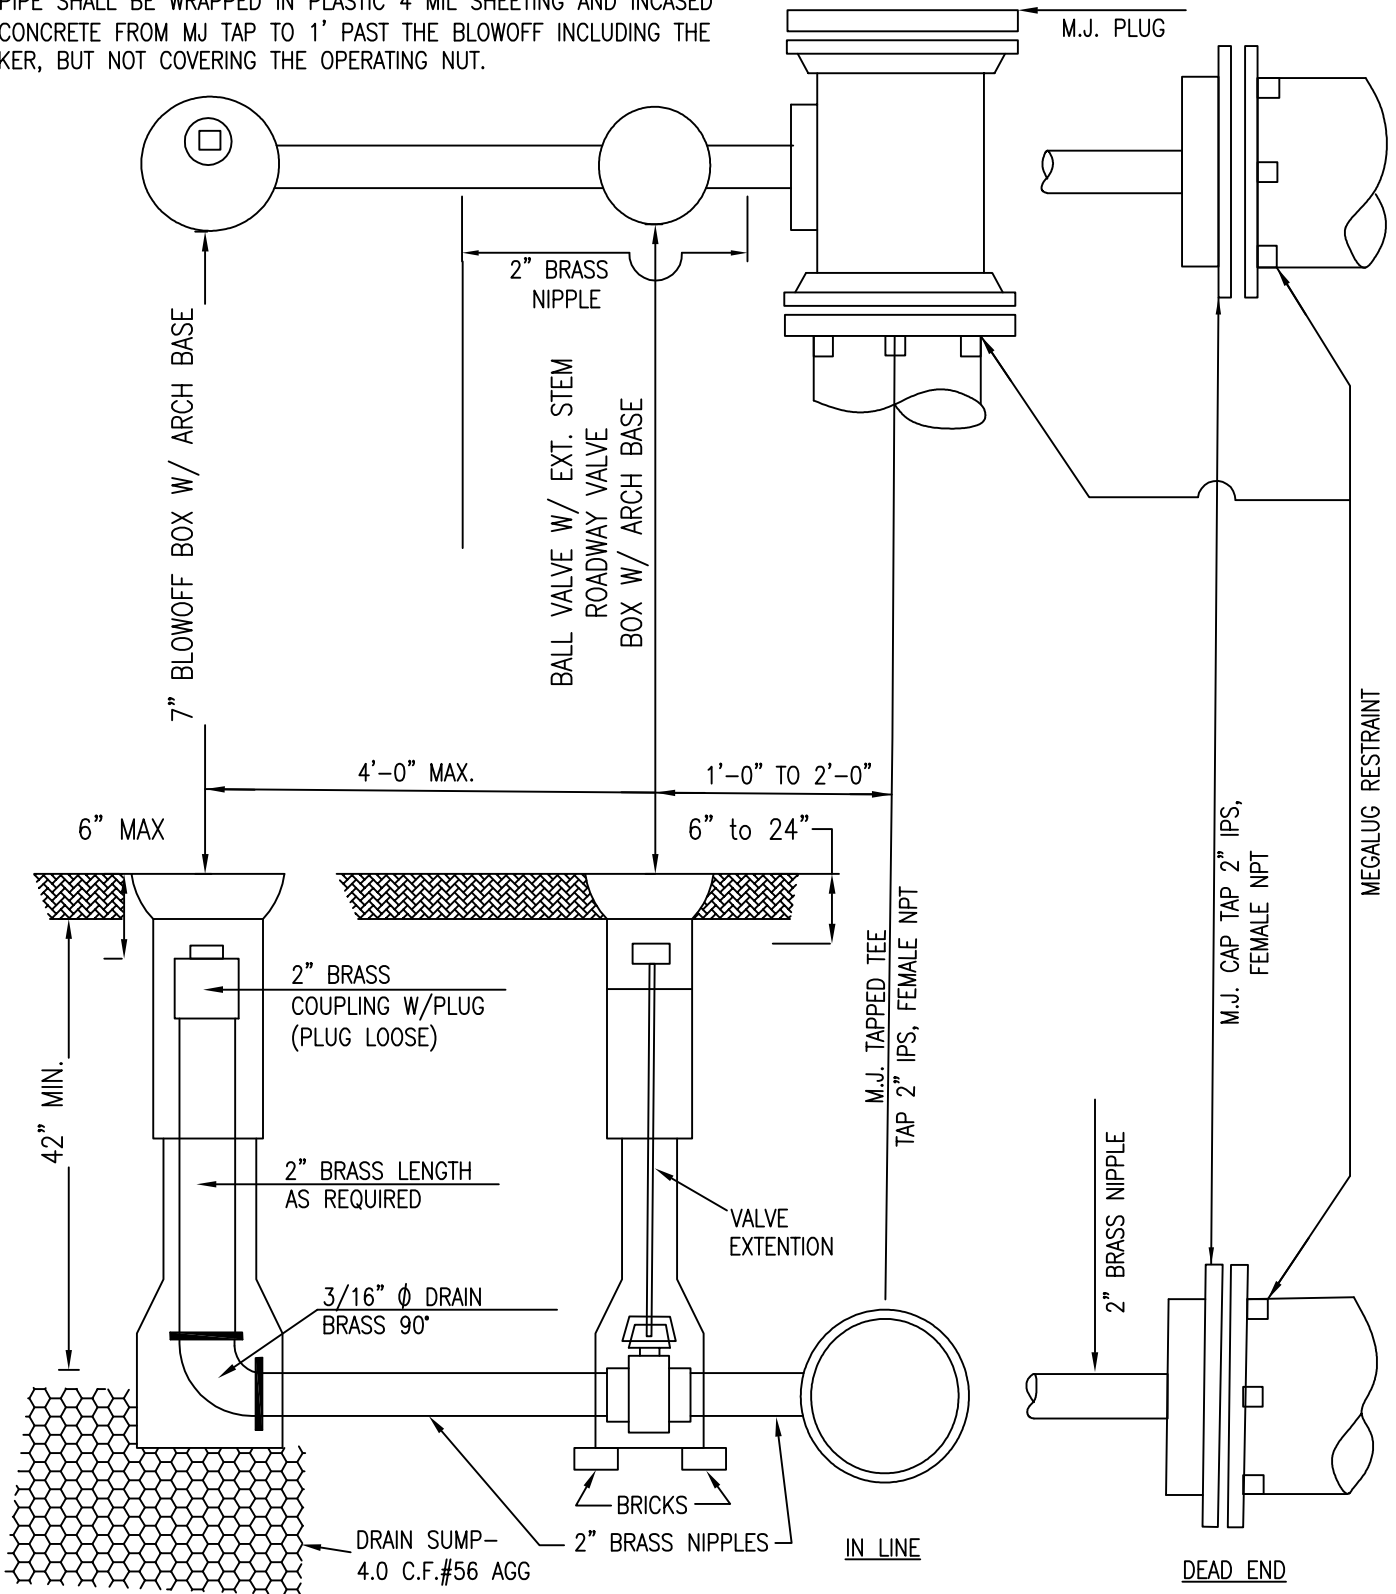

Jefferson Utilities Inc.

270 Industrial Boulevard
Kearneysville, WV 25430

BLOW-OFF ASSEMBLY

Not to Scale

W-3.03

REVISED:
June 18, 2014